


NOTES:

1. MINIMUM VERTICAL SEPARATION AT ALL UTILITY CROSSINGS SHALL BE 6" CLEAR, UNLESS OTHERWISE APPROVED BY THE CITY ENGINEER.
2. SEE DRAWING NO.S 6110 AND 6140.

WATER MAIN - DEPTH SCHEDULE		
SIZE OF MAIN (INCHES)	MIN. COVER BELOW FIN. GRADE (FEET)	MIN. COVER BELOW SUBGRADE (FEET)
6	3.5 OR	2.5 (WHICHEVER IS DEEPER)
8	4.0 OR	3.0 (WHICHEVER IS DEEPER)
10	4.0 OR	3.0 (WHICHEVER IS DEEPER)
12	4.0 OR	3.0 (WHICHEVER IS DEEPER)

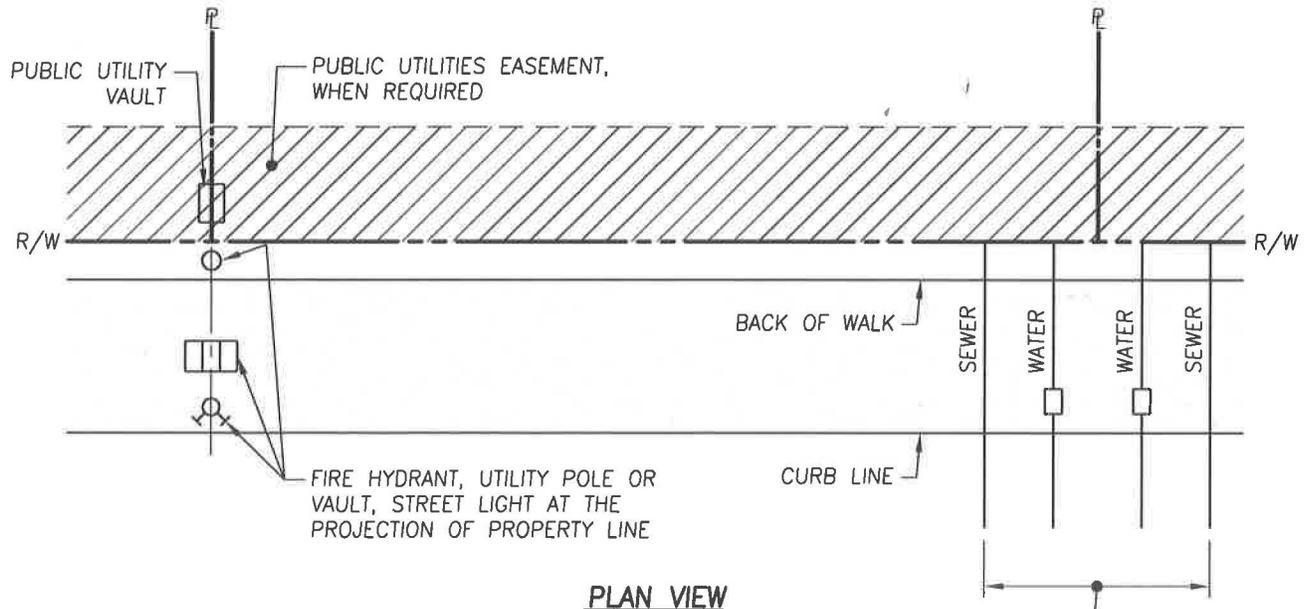


PLAN VIEW

SEE DESIGN GUIDELINES FOR PLACEMENT OF SEWER LATERALS AND WATER LATERALS

NOTE:
STAMP TOP OF CURB W/3" TO 4" TALL "S" FOR SANITARY SEWER LATERALS AND "W" FOR WATER LATERALS.

REVISIONS	DATE



CITY OF TULARE
PUBLIC IMPROVEMENT STANDARD
UTILITY LOCATIONS

DRAWING NO.:
6010

Approved By: *Michael W. Miller*
Date: 11/15/16 City Engineer

1 OF 1