
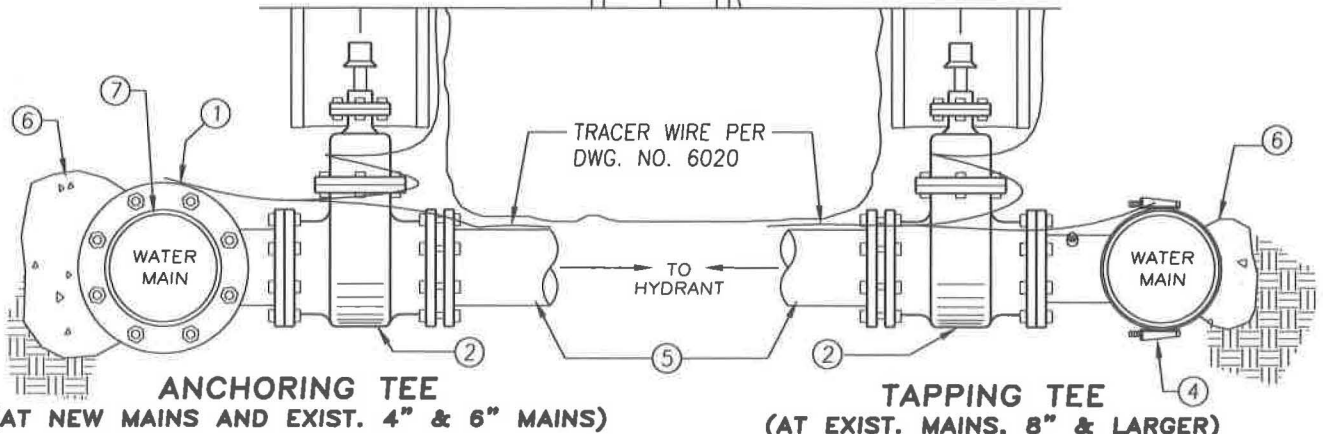


NOTES:

- ① CUT-IN TEE—M.J. X M.J. X FLANGE AT 6" MAINS. IF REGULAR LINE RUN TEE IS USED, A SWIVEL X SOLID ADAPTER (PUP) SHALL BE USED (SEE DWG. NO. 6330).
- ② GATE VALVE, FLANGE X M.J., RESILIENT SEATED WITH FULLY-ENCAPSULATED GATE, EPOXY-COATED INSIDE & OUTSIDE, FULL-SIZE WATERWAY, OPEN TO THE LEFT, NON-RISING STEM WITH O-RING SEALS, AVK, CLOW F-6100, OR APPROVED EQUAL, AND SHALL CONFORM TO AWWA STANDARD C-509.
- ③ SEE DWG. NO. 6325 FOR VALVE, VALVE WELL & COLLAR DETAILS.

- ④ TAPPING SLEEVE — ROMAC SST-STAINLESS STEEL, OR APPROVED EQUAL. SEE DWG. NO. 6335.
- ⑤ LATERALS SHALL BE PVC (DR-18) OR DUCTILE IRON, 6 INCH MIN. DIAMETER.
- ⑥ THRUST BLOCK, CLASS 3 P.C.C., SHIELDED FROM FLANGES AND BOLTS.
- ⑦ SEE DWG. NO. 6335 FOR CUT-IN-TEE AT EXISTING 4" AND 6" MAINS.

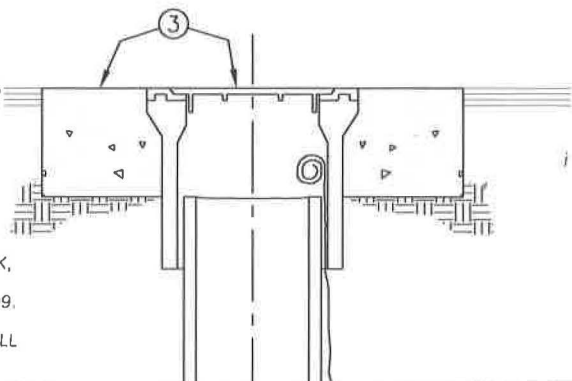

REVISIONS	DATE		CITY OF TULARE PUBLIC IMPROVEMENT STANDARD	
			FIRE HYDRANT ASSEMBLY	
			Approved By: <i>Michael W. Miller</i>	6310
			Date: 11/15/16 City Engineer	1 OF 1