



TRAFFIC VALVE WELL & COVER TYLER UNION TU-G05, WITH EXTENSIONS AS REQ'D. OR APPV'D EQUAL. COVER SHALL BE IMPRINTED WITH "WATER".

COLLAR SHALL BE CONSTRUCTED PER DWG. NO. 6030

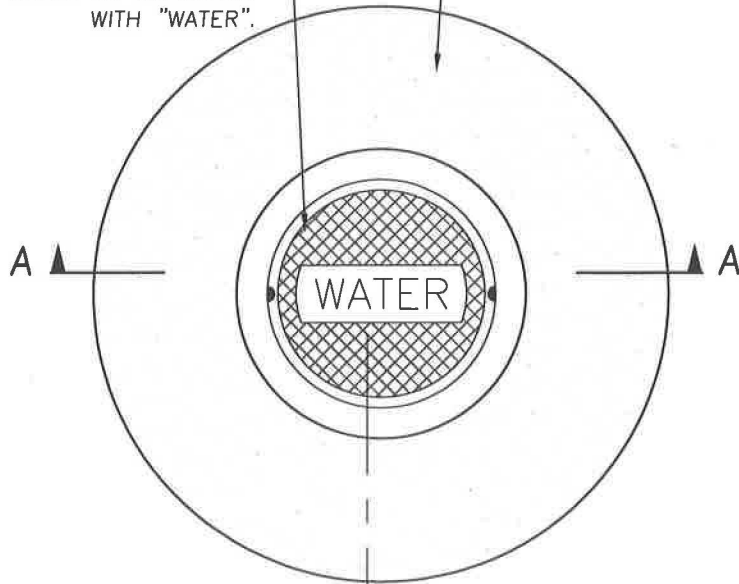

18" OF TRACER WIRE ROLLED INSIDE UTILITY WELL.

CONCRETE COLLAR

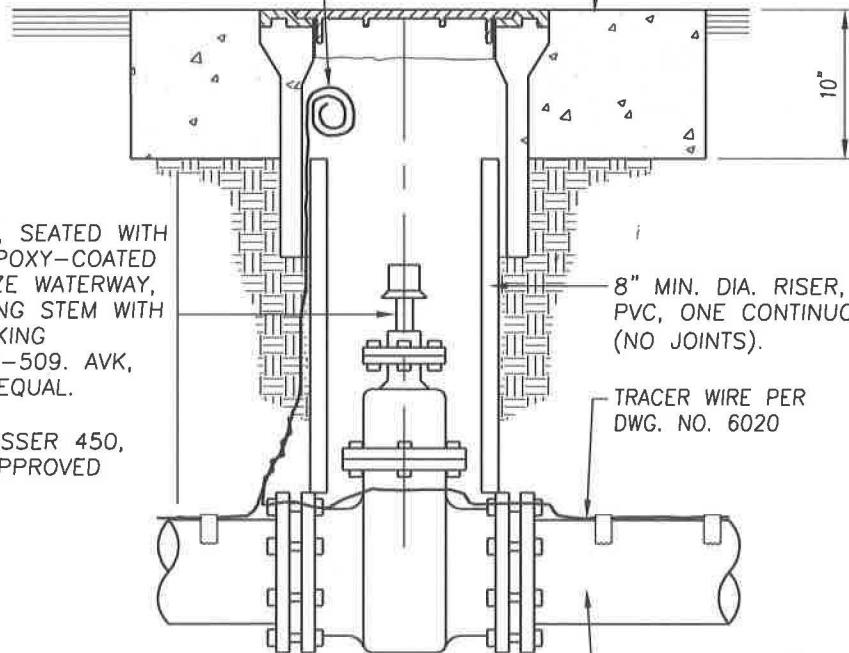

WATER VALVE

10" OR SMALLER MAINS:
GATE VALVE, MJXMJ, RESILIENT, SEATED WITH FULLY ENCAPSULATED GATE, EPOXY-COATED INSIDE AND OUTSIDE, FULL-SIZE WATERWAY, OPEN TO THE LEFT, NON-RISING STEM WITH O-RING SEALS, 200 PSI. WORKING PRESSURE, AND MEET AWWA C-509. AVK, CLOW F-6100 OR APPROVED EQUAL.
12" OR LARGER MAINS:
MJXMJ, BUTTERFLY VALVE, DRESSER 450, MUELLER LINE SEAL ILL, OR APPROVED EQUAL.


8" MIN. DIA. RISER, SDR 35 PVC, ONE CONTINUOUS PIECE (NO JOINTS).

TRACER WIRE PER DWG. NO. 6020

PVC WATERLINE SPIGOTS (12" AND LARGER SHALL BE BEVELED ON INSIDE FOR BUTTERFLY VALVE VANE CLEARANCE.

SECTION A-A

REVISIONS	DATE



CITY OF TULARE PUBLIC IMPROVEMENT STANDARD	
WATER VALVE AND WELL	DRAWING NO.:
Approved By: <i>Michael W. Miller</i>	6325
Date: 11/15/16	City Engineer
1 OF 1	