


ARTERIAL OR COLLECTOR

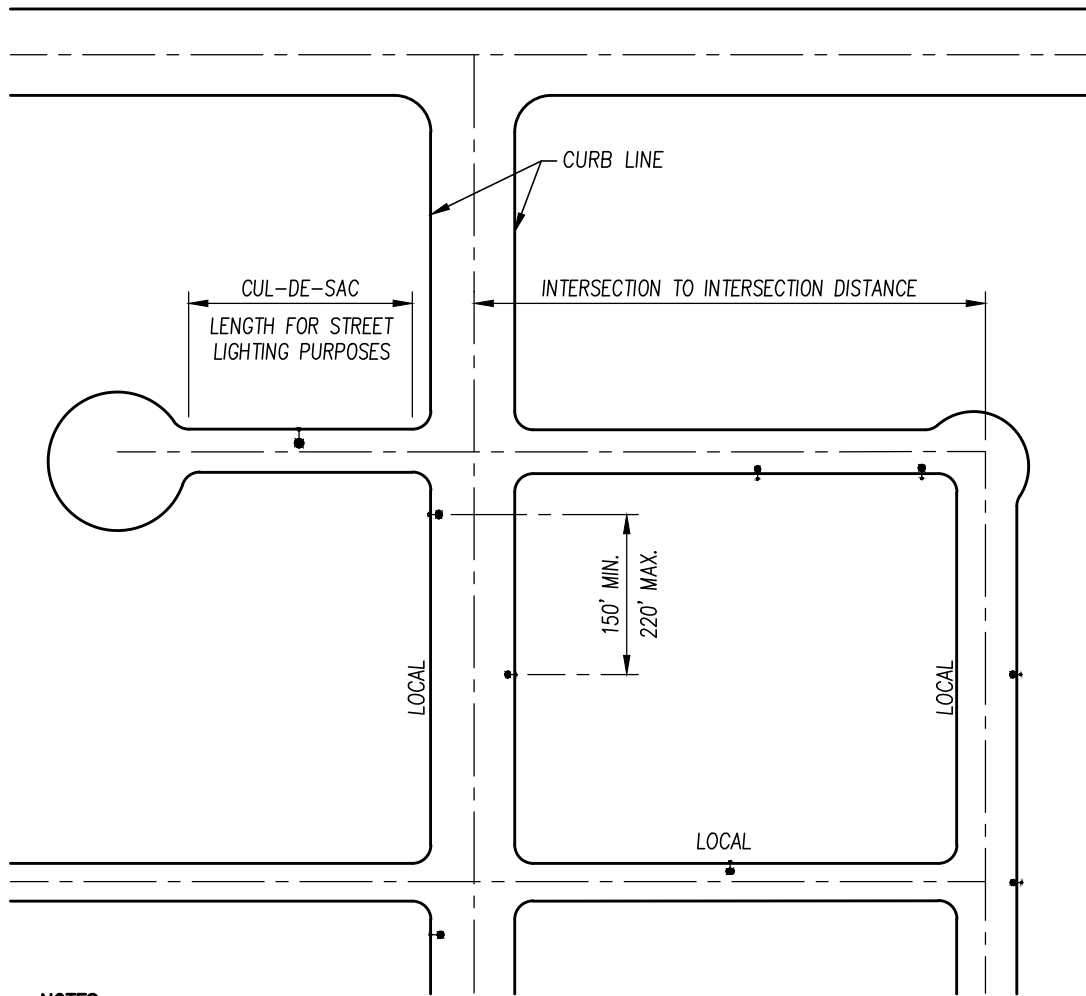

NOTES:

1. STREETLIGHTS ON LOCAL STREETS SHALL BE 70 WATT - 5,800 LUMEN, LED LAMPS WITH CUT-OFF LUMINARIES, LUMINAIRE ELEVATION OF 26', MOUNTED ON MARBLELITE POLES WITH 6' MAST ARMS AS PER SOUTHERN CALIFORNIA EDISON COMPANY STANDARDS. ALTERNATIVE STREETLIGHT POLES ARE SUBJECT TO APPROVAL BY THE CITY ENGINEER.
2. STREETLIGHTS SHALL BE INSTALLED AT LOCATIONS AS DETERMINED BY THE CITY ENGINEER UPON REVIEW OF SUBMITTED IMPROVEMENT PLANS.
3. A STREETLIGHT SHALL BE INSTALLED AT EACH INTERSECTION. SHOULD THE DISTANCE BETWEEN INTERSECTIONS EXCEED 360', AN INTERMEDIATE STREETLIGHT, OR STREETLIGHTS, SHALL BE INSTALLED. SPACING OF STREETLIGHTS BETWEEN INTERSECTIONS WHERE REQUIRED SHALL BE 150' MINIMUM TO 220' MAXIMUM.
4. CUL-DE-SACS SHALL HAVE A MINIMUM OF ONE STREETLIGHT AND SHALL FOLLOW THE SPACING REQUIREMENTS MENTIONED ABOVE.
5. ALL STREETLIGHTS INSTALLED OR REPLACED IN THE CENTRAL BUSINESS DISTRICT ARE SUBJECT TO APPROVAL BY THE CITY ENGINEER.

REVISIONS		DATE		CITY OF TULARE PUBLIC IMPROVEMENT STANDARD LOCAL STREET LIGHTING		DRAWING NO.:
MAST ARM LENGTH, LUMINAIRE HT., CUL DE SAC, LOCATION.		8/7/17		<i>Michael W. Miller</i> Approved By:		7310
				Date: 08/07/17		
				City Engineer		
						1 OF 1